

GAS WIRING DIAGRAM


ZGW124, ZGW125

WARNING

POWER MUST BE DISCONNECTED BEFORE SERVICING THIS APPLIANCE

CAUTION: LABEL ALL WIRES PRIOR TO DISCONNECTION WHEN SERVICING CONTROLS. WIRING ERRORS CAN CAUSE IMPROPER AND DANGEROUS OPERATION.

VERIFY PROPER OPERATION AFTER SERVICING

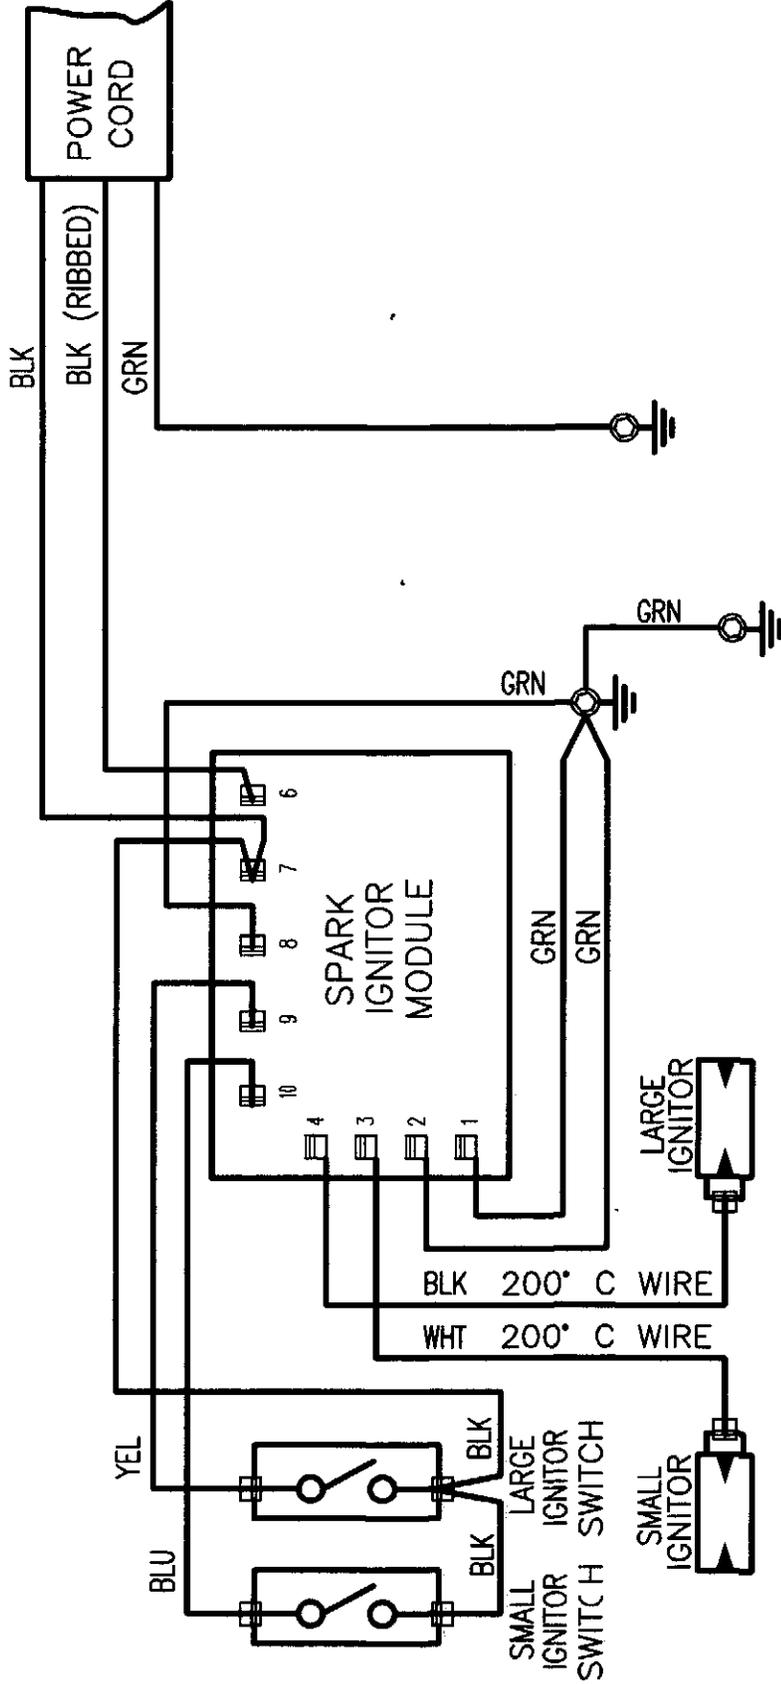

NOTE: FOR SERVICE REPLACEMENT USE 16 GA. 150° C WIRE EXCEPT AS INDIVIDUALLY

NOTED ON LEADS.

953-0489-002 02/98

ZGW124, ZGW125